


NOTE: WATER METER IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR WATER DISTRIBUTION. ALL FITTINGS TO BE COMPRESSION JOINT TYPE AS APPROVED BY THE CITY ENGINEER.

MINIMUM TAP SPACING SHALL BE 2' O.C.

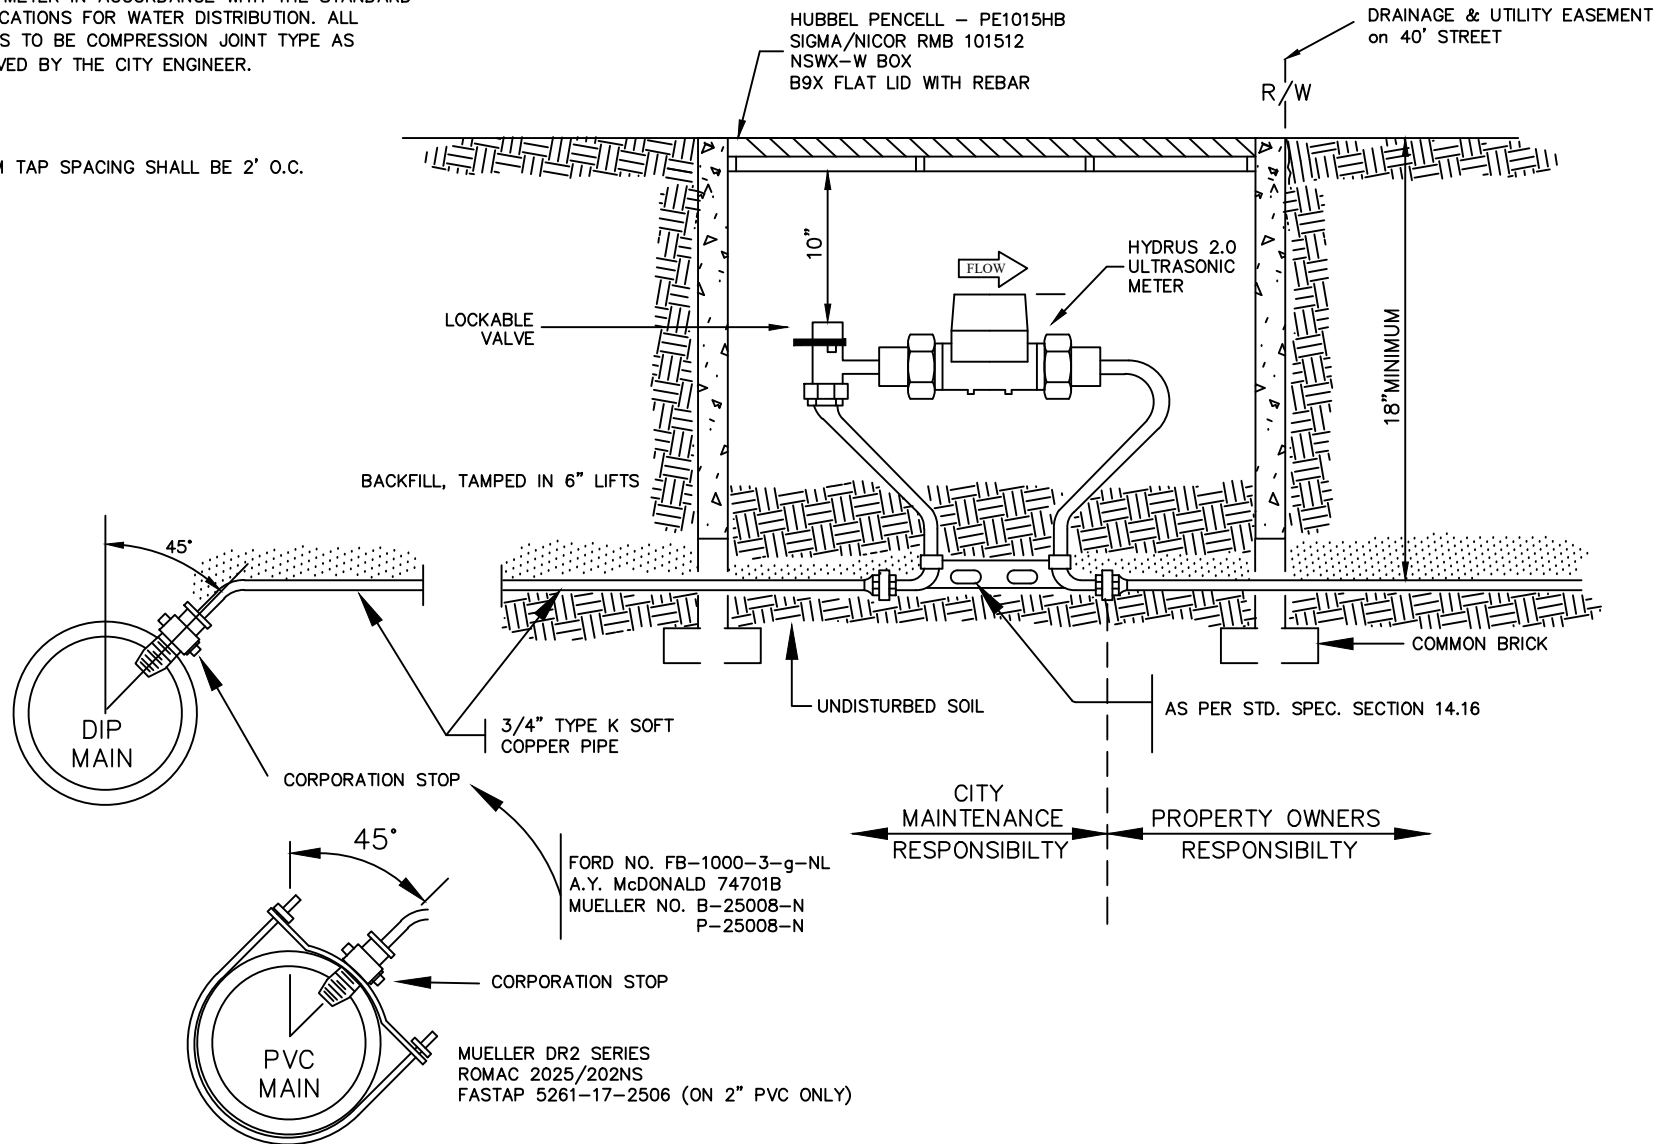

REVISED	DATE: AUG. 14, 1984	Standard Detail 3/4" x 5/8" Water Tap and Meter Details	OFFICE OF THE CITY ENGINEER GASTONIA, N.C.
02-02-01	SCALE: NTS		
05-23-01	DRAWN BY: MLB, EZ, JW		FILE NO. 71B-20
03-10-03	CHECKED BY: DCC, FAP		
03-03-09	CITY ENGINEER: FAP		
01-09-26			
08-20-26			