
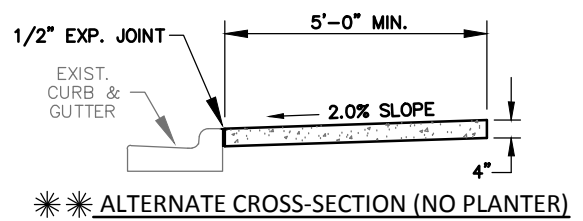


CONCRETE SIDEWALK
TYPICAL PLAN

NOTES:

1. WHEN FRONT EDGE OF WALK IS POURED ADJACENT TO CURB OR BACK OF WALK IS POURED ADJACENT TO A BUILDING OR EXISTING CONCRETE, A 1/2" EXPANSION JOINT SHALL BE PLACED BETWEEN NEW WALK AND EXISTING STRUCTURES; WHERE A DRIVEWAY CROSSES A WALK, THE SIDEWALK SHALL HAVE A DEPTH OF 6" WITH 1/2" EXPANSION JOINT EACH SIDE OF WALK.
- * 2. 5' WIDTH REQUIRED ON NCDOT ROADS, THOROUGHFARE, OR WHEN ADJACENT TO BACK OF CURB.
- ** 3. SPECIAL APPROVAL REQUIRED.

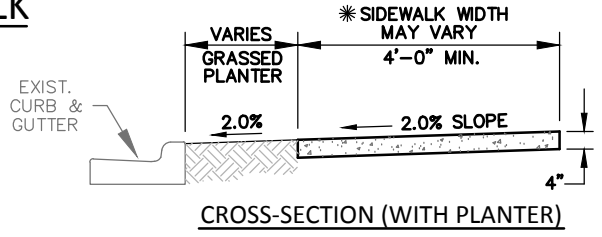

REVISED	DATE: 03-21-2017	Standard Detail	OFFICE OF THE CITY ENGINEER GASTONIA, N.C.
	SCALE: NONE		
	DRAWN BY: MGB	Sidewalk Detail - Concrete	FILE NO. 71D-14
	CHECKED BY: TAJ		
	CITY ENGINEER: CCB		